



DEPT OF BLDGS 240168554 Job Number

ES703080015 Scan Code

Environmental  
Protection

6/4/2015

**Emily Lloyd**  
Commissioner

Automated Design Consultants  
15 Hardscrabble Hill Road  
Chappaqua, New York 10514  
Attn: Gregory Mortman, P.E.

To Whom It May Concern:

**James J. Roberts**  
Deputy Commissioner  
Bureau of Water &  
Sewer Operations

The hydrant flow test you requested in the vicinity of **500 Oak Point Avenue, Bronx** was performed on **6/4/2015** at **10:20 AM** with the following results:

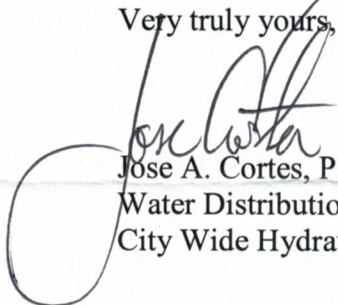
59-17 Junction Blvd.  
Flushing, NY 11373

The static pressure taken on a 12 inch water main which is fed from two directions on the south side of Oak Point Avenue 1st hydrant west of Dupont Street was 46 pounds per square inch. The residual pressure at this point was 44 pounds per square inch when 1000 gallons of water per minute were flowing from the south side of Oak Point Avenue 1st hydrant east of Dupont Street.

This Department cannot guarantee that this pressure will be maintained in the future because a change may be needed in conformity with good engineering practices.

If you have any questions regarding engineering, and application status, please call (718) 595-3958.

Very truly yours,

  
Jose A. Cortes, P.E.  
Water Distribution Engineer  
City Wide Hydraulic Testing Unit

File: FT2015-1014-209328

All hydrant flow test requests are to be addressed to: NYCDEP-BWSO; 59-17 Junction Blvd, 12<sup>th</sup> Fl., Flushing; NY 11373-5108, Attn: Citywide Hydraulic Flow Test Unit

Enclose payment for \$500 payable to NYC Water Board for each test. Indicate the test street, cross streets and borough for each test. All requests are to be made by US or overnight mail, no hand deliveries accepted.