



Environmental
Protection

Emily Lloyd
Commissioner

James J. Roberts
Deputy Commissioner
Bureau of Water &
Sewer Operations

59-17 Junction Blvd.
Flushing, NY 11373

DEPT OF BLDGS320909102 Job Number

ES233382326 Scan Code

10/20/2015

Infocus Design & Planning, Inc.
86-16 Queens Boulevard, Suite # 205
Elmhurst, New York 11373
Attn: Wu Chen, P.E.

To Whom It May Concern:

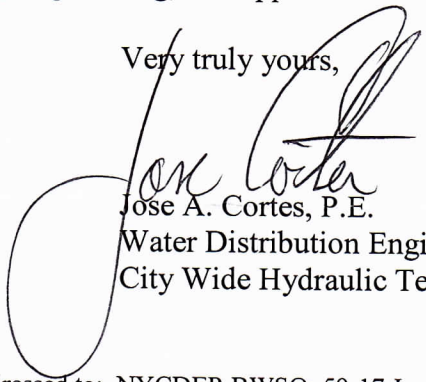
The hydrant flow test you requested in the vicinity of **490 Van Buren Street, Brooklyn** was performed on **10/19/2015** at **2:45 PM** with the following results:

The static pressure taken on an 8 inch water main which is fed from two directions on the south side of Van Buren Street 1st hydrant west of Patchen Avenue was **42** pounds per square inch. The residual pressure at this point was **41** pounds per square inch when 500 gallons of water per minute were flowing from the south side of Van Buren Street 1st hydrant east of Malcolm X Boulevard.

This Department cannot guarantee that this pressure will be maintained in the future because a change may be needed in conformity with good engineering practices.

If you have any questions regarding engineering, and application status, please call (718) 595-3958.

Very truly yours,


Jose A. Cortes, P.E.
Water Distribution Engineer
City Wide Hydraulic Testing Unit

File: FT2015-2314-317134

All hydrant flow test requests are to be addressed to: NYCDEP-BWSO; 59-17 Junction Blvd, 12th Fl., Flushing; NY 11373-5108, Attn: Citywide Hydraulic Flow Test Unit

Enclose payment for \$500 payable to NYC Water Board for each test. Indicate the test street, cross streets and borough for each test. All requests are to be made by US or overnight mail, no hand deliveries accepted.