



3/26/2015

Emily Lloyd
Commissioner

Sideris Kefalas Engineers P.C.
217-22 Northern Boulevard
Bayside, New York 11361
Attn: Rony Vargas

To Whom It May Concern:

James J. Roberts
Deputy Commissioner
Bureau of Water &
Sewer Operations

59-17 Junction Blvd.
Flushing, NY 11373

The hydrant flow test you requested in the vicinity of **23 thru 25 Fayette Street, Brooklyn** was performed on **3/16/2015** at **12:30 PM** with the following results:

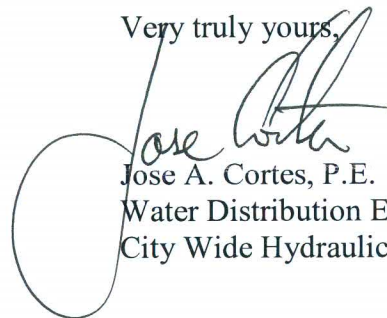
The static pressure taken on the west side of Fayette Street 1st hydrant north of Broadway was 56 pounds per square inch. The residual pressure at this point was 54 pounds per square inch when 500 gallons of water per minute were flowing from the south side of Broadway 1st hydrant east of Fayette Street.

This Department cannot guarantee that this pressure will be maintained in the future because a change may be needed in conformity with good engineering practices.

The flow test was performed on an 8 inch water main, which is fed from two directions.

If you have any questions regarding engineering, and application status, please call (718) 595-3958.

Very truly yours,


Jose A. Cortes, P.E.
Water Distribution Engineer
City Wide Hydraulic Testing Unit

File: FT2015-0270-311862

All hydrant flow test requests are to be addressed to: NYCDEP-BWSO; 59-17 Junction Blvd, 12th Fl., Flushing; NY 11373-5108, Attn: Citywide Hydraulic Flow Test Unit

Enclose payment for \$500 payable to NYC Water Board for each test. Indicate the test street, cross streets and borough for each test. All requests are to be made by US or overnight mail, no hand deliveries accepted.